
QuikDraw Diagram Supplement Sheet
External Call Annunciation / External Signaling

External Call Annunciation with IER-2

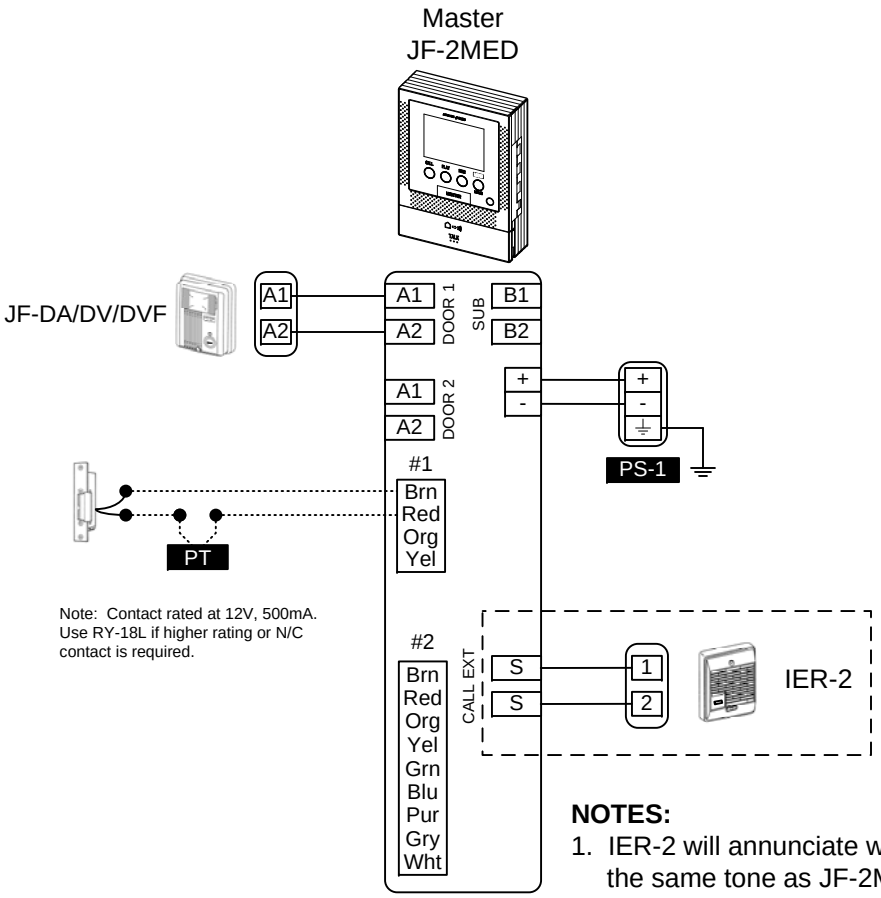


NOTES:

1. IER-2 will annunciate with the same tone as JF-2MED Master station.
2. A maximum of (2) IER-2 may be used in parallel.
3. All other connections typical per QuikDraw diagram issued, main page.

External Signaling with RY-ES

NOTES:

1. RY-ES provides a Normally Open dry contact corresponding to the chime tone (Orange wires).
2. RY-ES shares power with the JF master monitor.
3. A separate power source is required for your bell/sounder.
4. All other connections typical per QuikDraw diagram issued, main page.

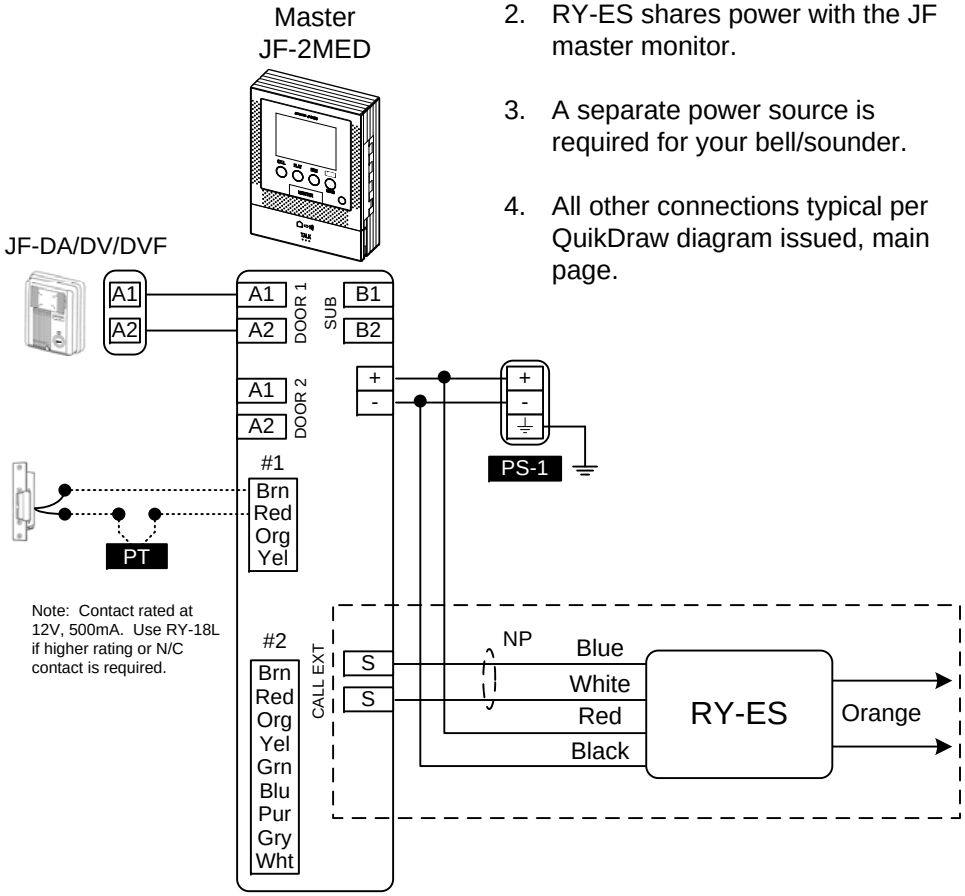

Disclaimer: *This diagram is provided as a service only, based on standard system configurations. Actual installation parameters may vary. Aiphone Corporation does not warrant or assume any legal liability for this information, nor is Aiphone responsible for installation accuracy or costs incurred involving on-site service.*