

SYSTEM/MODEL: LEF

MODIFICATION: Various relay contacts using the LEF system

DIFFICULTY LEVEL: 2 - Easy/moderate - Component connection to external points.

COMPONENTS REQUIRED: 1. RY-AC: External signaling relay
2. RY-PA: 12V DC normally open relay.

INSTR/OPERATIONS: 1. See following diagram for options on closures available.


REFERENCE DRAWING #: 0798-1310

**Aiphone's product warranty applies to products properly modified using these instructions.
However, if a unit is damaged as a result of improper modification, the warranty does not apply.**


MODIFICATION DIAGRAM

VARIOUS RELAY CONTACTS FROM THE LEF SYSTEM


1) EXTERNAL SIGNALLING

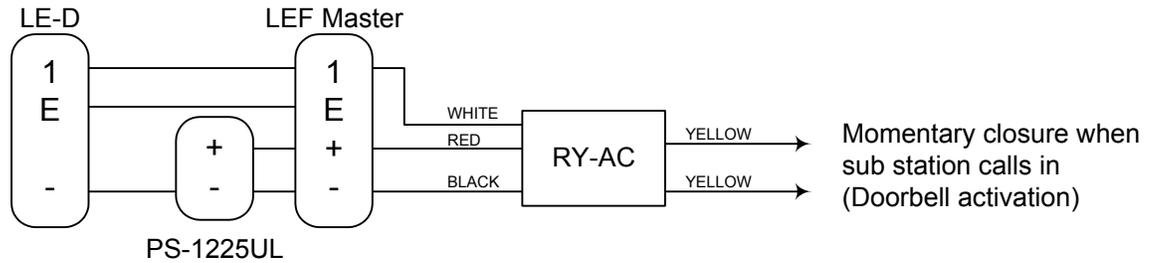


2) SELECTIVE DOOR RELEASE

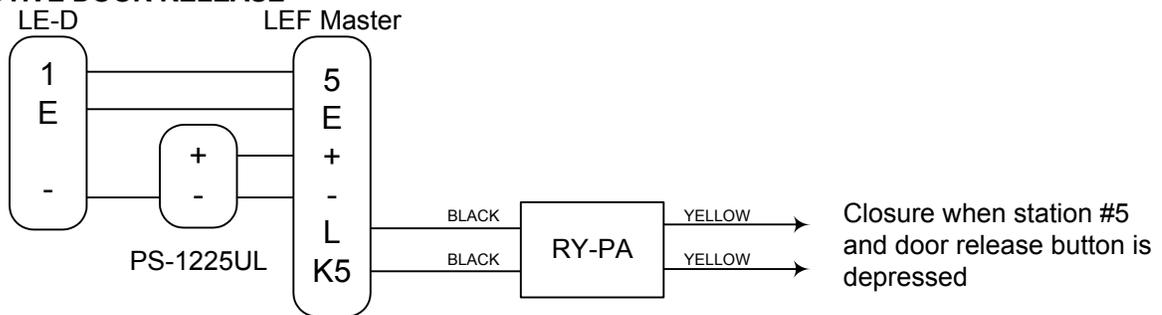

3) CAMERA CONTROL/LIGHT ACTIVATION

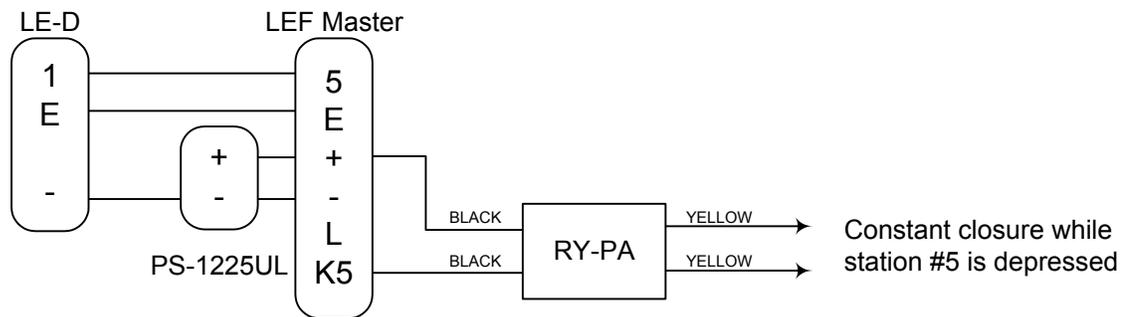

4) BOTH DOOR RELEASE AND CAMERA CONTROL/LIGHT ACTIVATION

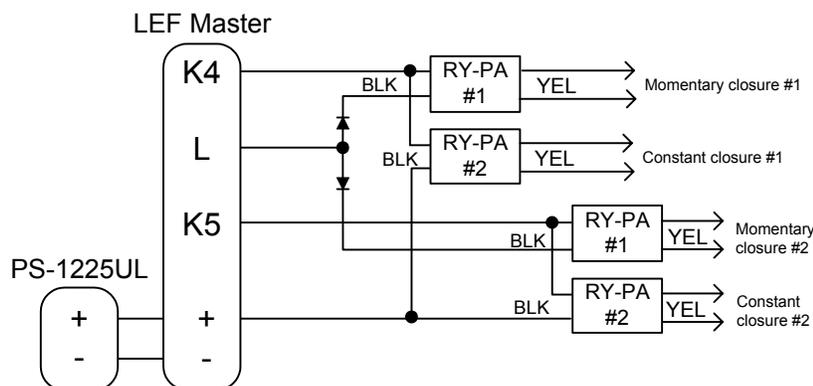

Each station that requires both a constant closure and momentary closure when a channel is selected requires the following:
 2 RY-PA relays
 2 Diodes (1N4001)