RUTHERFORD CONTROLS
A DORMA Group Company

10-5 SERIES POWER SUPPLY

10-5 WIRING DIAGRAM

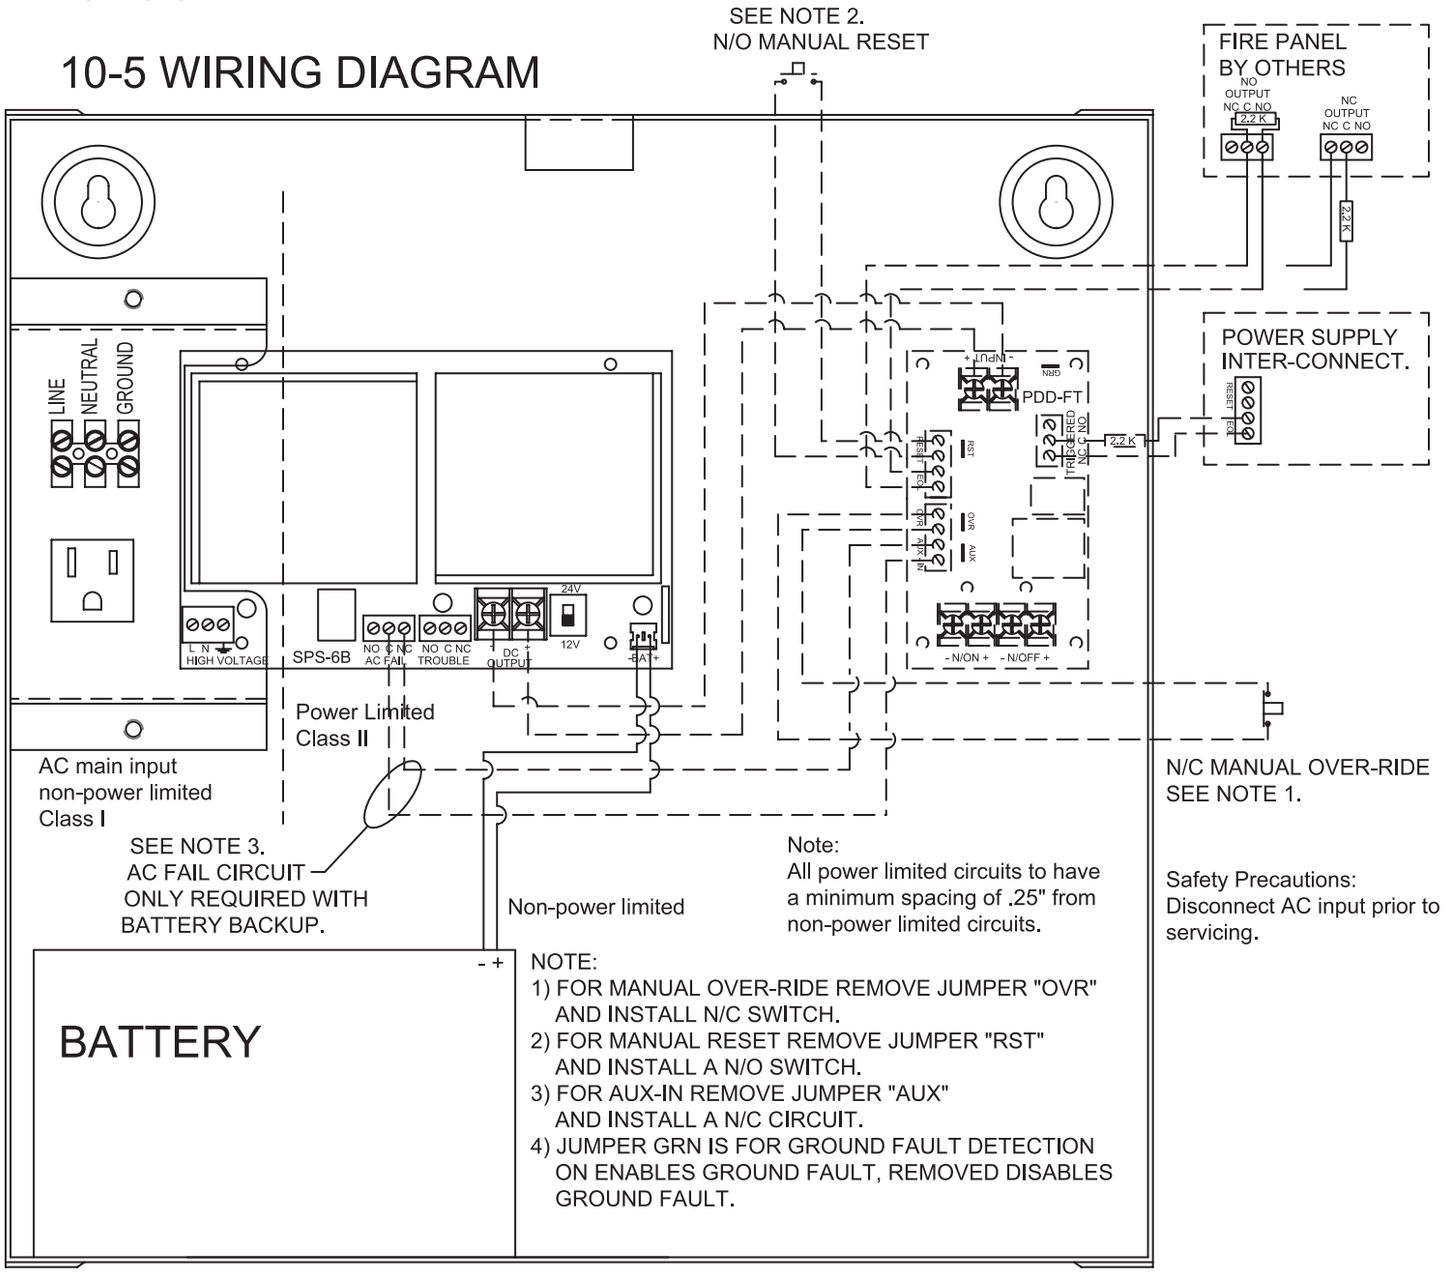

FIRE PANEL CONNECTIONS WITH BATTERY BACKUP
FOR AC FAIL TRIGGER LATCHING WITH N/O MANUAL RESET

NOTE: Drawing for reference purposes only.
Actual installations must follow local electrical and building codes.

SCH10PS1
PCN13023
R07/14TG