
INSTALLATION INSTRUCTIONS
MODELS TS-2-2, TS-3-2, TS-4-2, TS-5-2

U.L. FILE SA32686 CONFORMS TO U.L. STANDARD 294 FOR ACCESS CONTROL

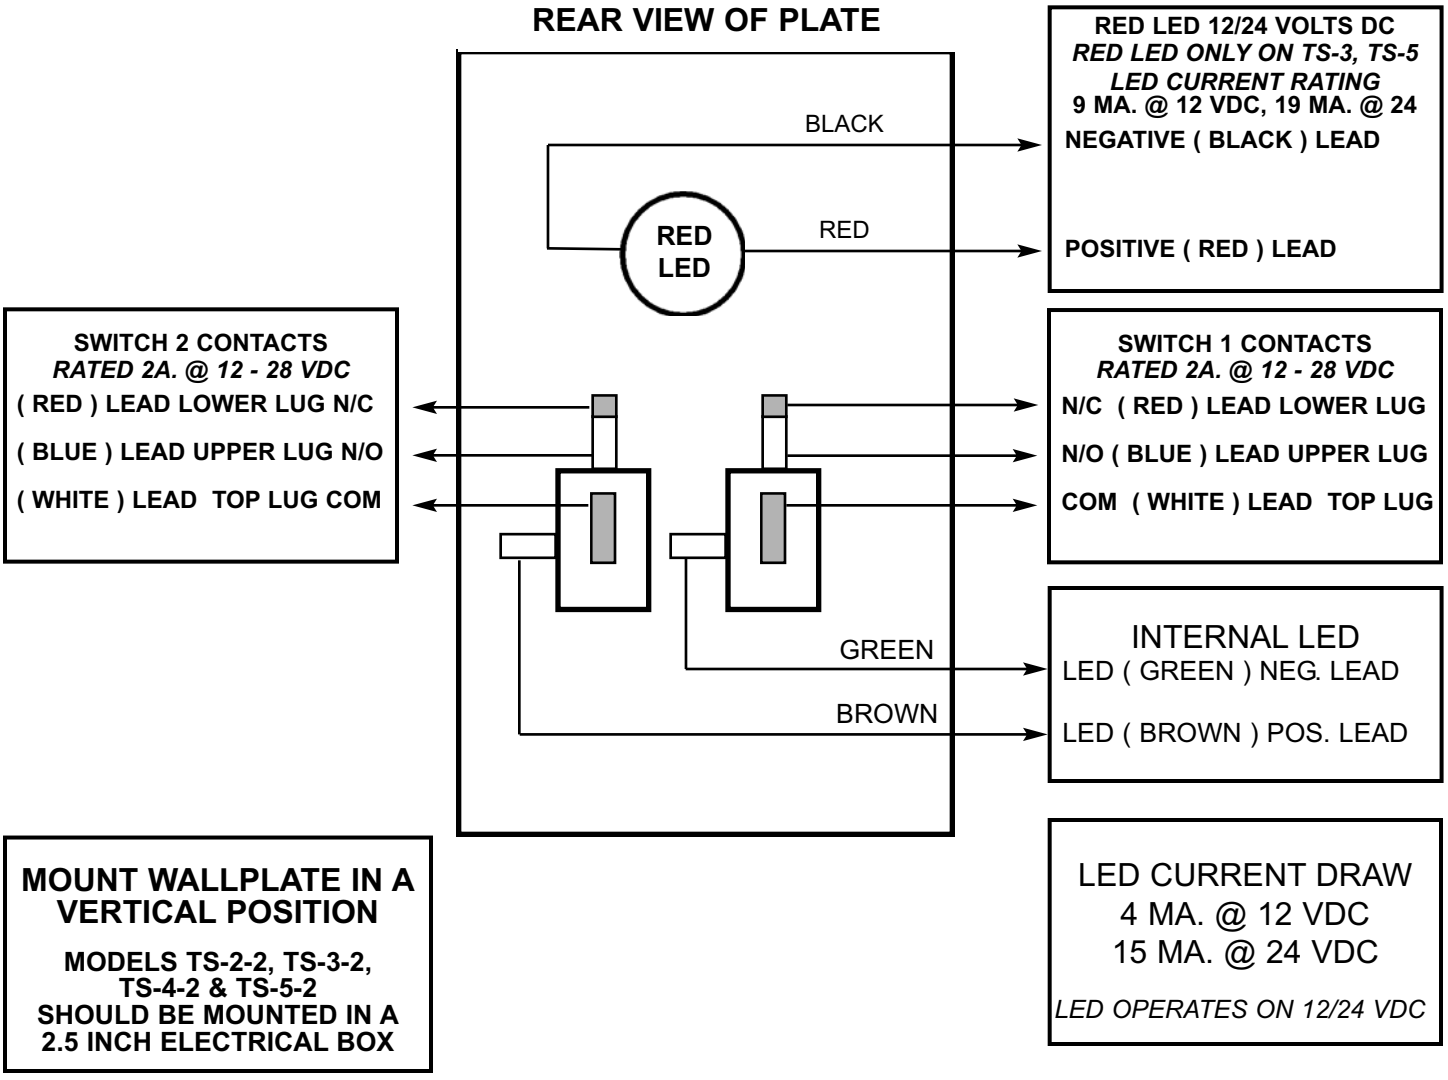

MOUNT WALLPLATE IN A VERTICAL POSITION

MODELS TS-2-2, TS-3-2, TS-4-2 & TS-5-2 SHOULD BE MOUNTED IN A 2.5 INCH ELECTRICAL BOX

LED CURRENT DRAW
4 MA. @ 12 VDC
15 MA. @ 24 VDC

LED OPERATES ON 12/24 VDC

ALARM CONTROLS CORPORATION

19 BRANDYWINE DRIVE P.O. BOX 280
DEER PARK, NY 11729
PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500
WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM

DOC. D-003 REV. B
4/09