
INSTALLATION INSTRUCTIONS
MODELS TS-2T, TS-3T, TS-4T, TS-5T

U.L. FILE SA32686

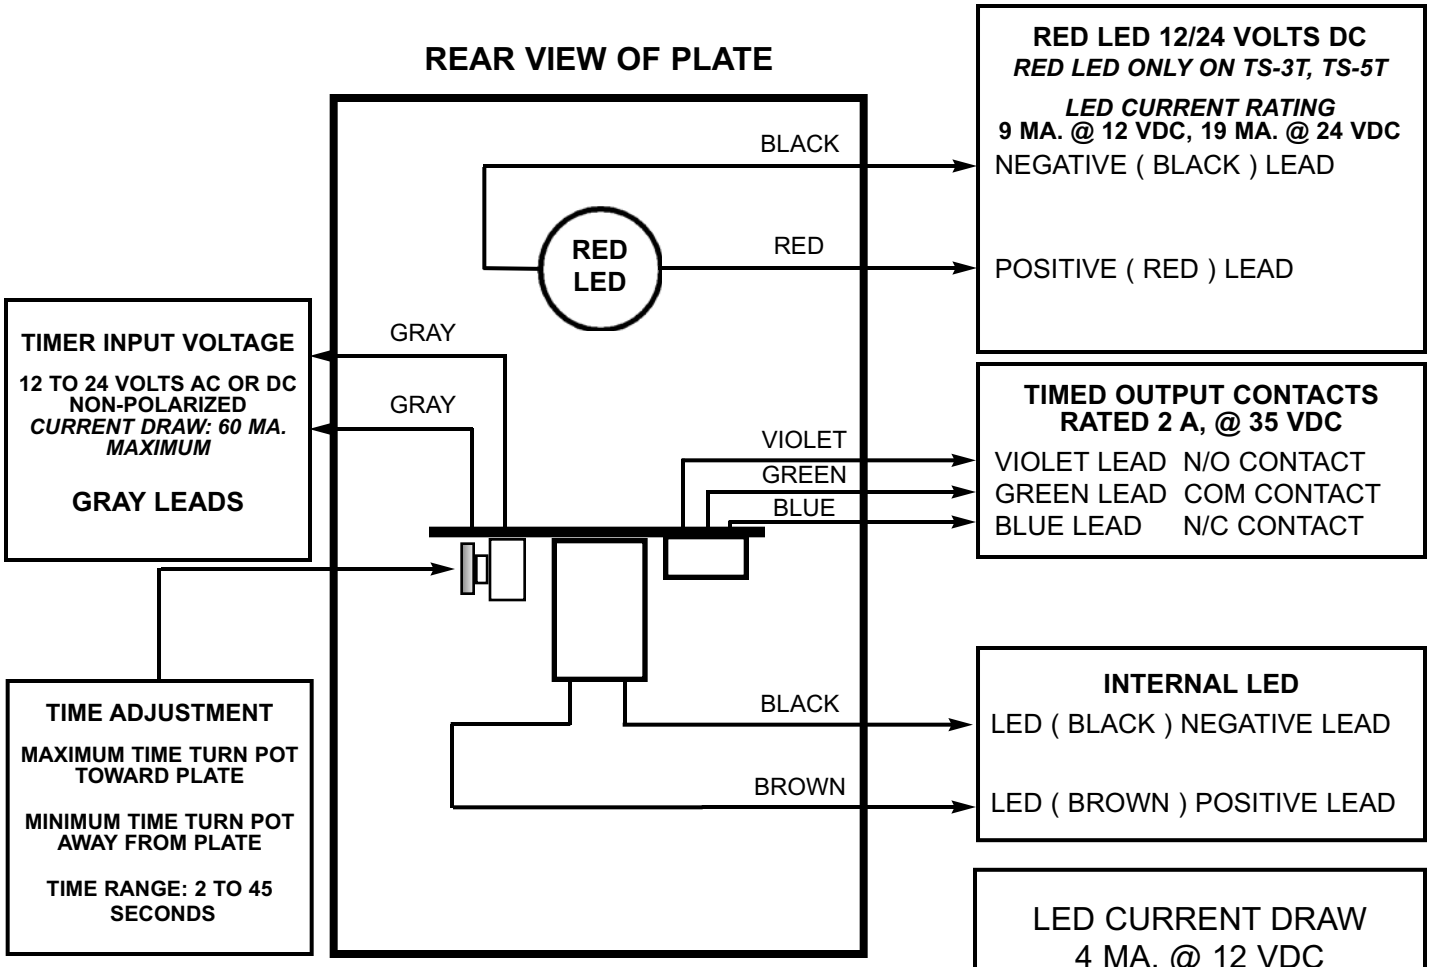

MOUNT WALLPLATE IN A VERTICAL POSITION

MODELS TS-2T, TS-3T, TS-4T & TS-5T SHOULD BE MOUNTED IN A 2.5 INCH DEEP ELECTRICAL BOX


NOTE: *TIMER WILL ACTIVATE WHEN **PUSH TO EXIT*** SWITCH *IS DEPRESSED.*
SUBSEQUENT DEPRESSIONS OF THE SWITCH WILL RE-START THE TIMER.

ALARM CONTROLS CORPORATION
19 BRANDYWINE DRIVE P.O. BOX 280
DEER PARK, NY 11729

PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500
WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM

DOC. D-007 REV. B
4/09

TYPICAL WIRING DIAGRAMS
FOR MODEL TS-2T

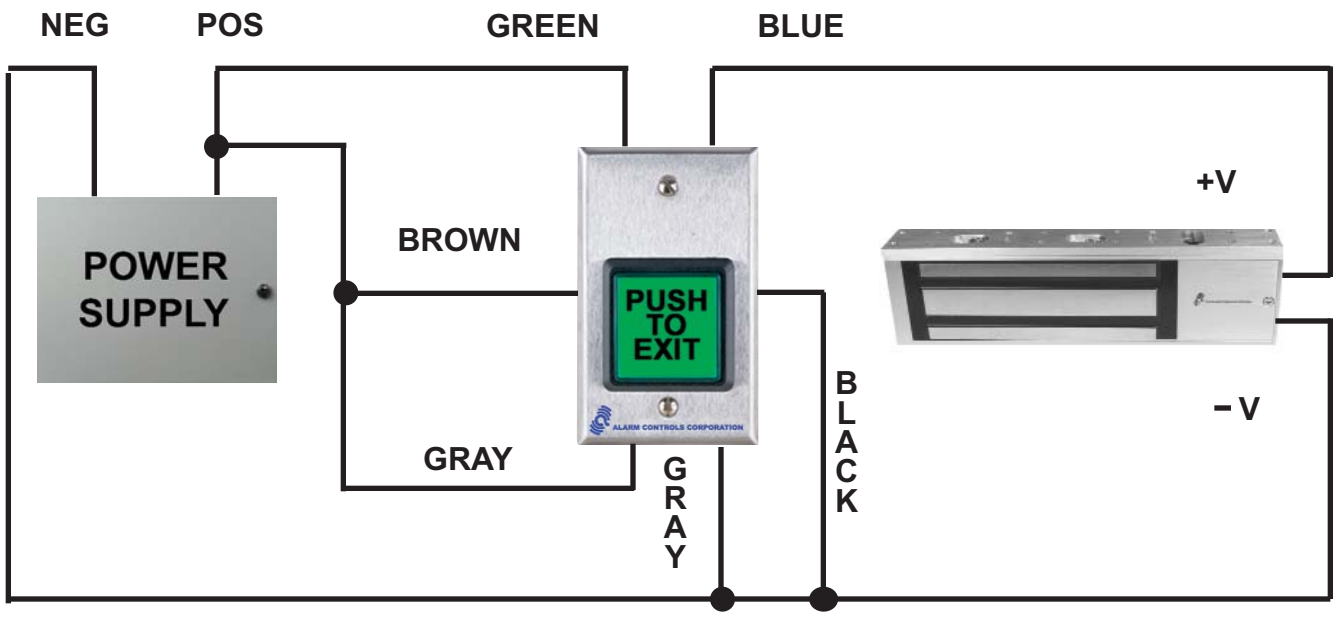

ELECTRIC DOOR STRIKE
FAIL SECURE MODE

