
# *INSTALLATION INSTRUCTIONS*
# *MODELS TS-6, TS-7, TS-8, TS-9*

**U.L. FILE SA32686**

**LEDS AVAILABLE ONLY ON TS-6 AND TS-8**
***LED CURRENT RATING***
**7 MA. @ 12 VDC, 15 MA. @ 24 VDC**

**REAR VIEW OF PLATE**

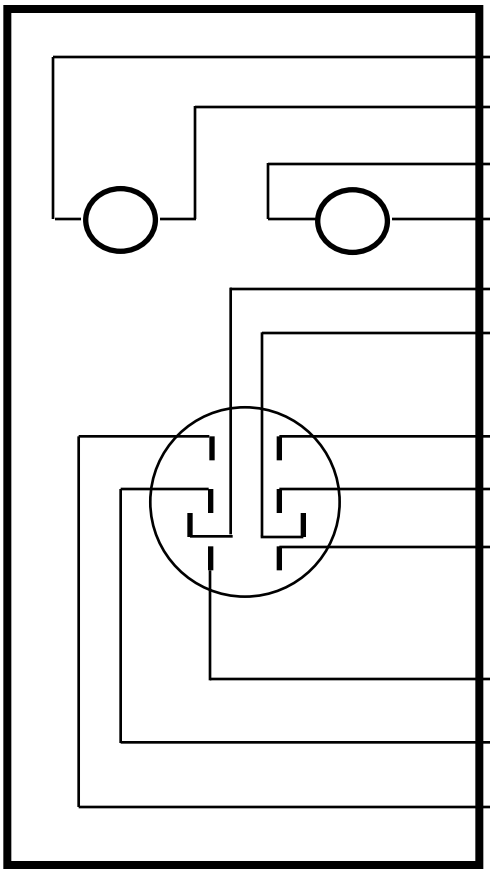

**BLACK LEAD NEGATIVE**
**RED LEAD POSITIVE** — **GREEN LED**

**BLACK LEAD NEGATIVE**
**RED LEAD POSITIVE** — **RED LED**

**YELLOW LEAD ( + ) POSITIVE**
**BLACK LEAD ( - ) NEGATIVE**

**SWITCH LED**
**9 MA. @ 12 OR 24 VOLTS DC**

**RED LEAD N/C CONTACT**
**BLUE LEAD N/O CONTACT**
**WHITE LEAD COM CONTACT**

**SWITCH 1**

**SWITCH CONTACTS**
***RATED 2 A. @ 12 - 28 VDC***

**WHITE LEAD COM CONTACT**
**BLUE LEAD N/O CONTACT**
**RED LEAD N/C CONTACT**

**SWITCH 2**

**MOUNT WALLPLATE IN A VERTICAL POSITION**

**MODELS TS-6, TS-7, TS-8 & TS-9 SHOULD BE MOUNTED IN A 2.5 INCH DEEP ELECTRICAL BOX**

***FOR 24 VOLT SWITCH LED OPERATION***

**ADD 100O OHM 1/2 WATT RESISTOR IN SERIES WITH YELLOW LEAD. INSULATE RESISTOR TO PREVENT SHORTING.**


## *ALARM CONTROLS CORPORATION*

***19 BRANDYWINE DRIVE P.O. BOX 280***
***DEER PARK, NY 11729***
***PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500***
***WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM***



DOC. D-004 REV. A
7/08