INSTALLATION 903

AUDIBLE ALERT

RUTHERFORD CONTROLS
A DORMA Group Company

In or Out... we make it Easy!®

Instructions

1. Slide the colored leads onto the switch terminals (shown below).

NOTE: 'N' version is compatible with 1-3/4" (44.4mm) (or larger) narrow-frame profiles. Specifications are subject to change without notice.

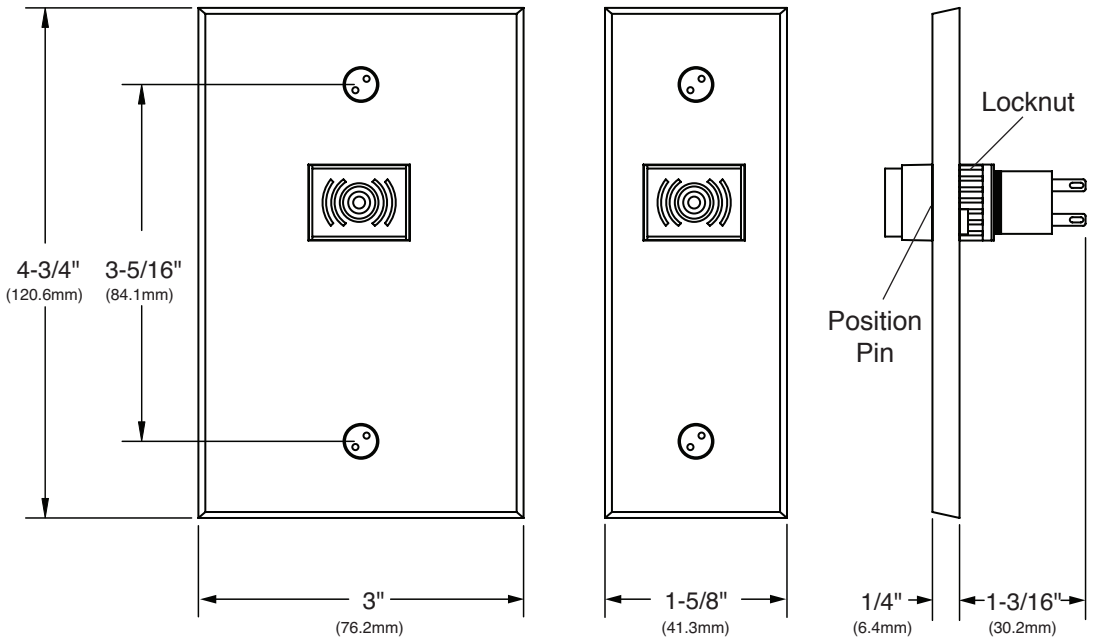

Voltage:	10 to 26VDC
Current Consumption:	≤ 20mA
Sound Pressure Level:	80-96dB @ 0.1m
Tone Frequency:	2.0 kHz

For Intermittent Tone
Positive (+) on A terminal; Negative (-) on B terminal

For Constant Tone
Positive (+) on B terminal; Negative (-) on A terminal

© 2014 RUTHERFORD CONTROLS INT'L | A DORMA GROUP COMPANY
WWW.RUTHERFORDCONTROLS.COM • PHONE: 1.800.265.6630 • FAX: 1.800.482.9795 • E-MAIL: SALES@RUTHERFORDCONTROLS.COM
PCN14044
R05/14TG