INSTALLATION 904

EMERGENCY PULL STATION

RUTHERFORD CONTROLS
A DORMA Group Company

In or Out... we make it Easy!®

Instructions

1. Clear lexan cover lifts easily to allow paddle to pull forward and release electric locking device.
2. Available in English/French or Spanish.
3. Mounts over standard surface or mortise electrical utility boxes (supplied by others).

Station in the closed position:

Pins 1 and 2	N/O
Pins 5 and 6	N/C
Pins 3 and 4	C

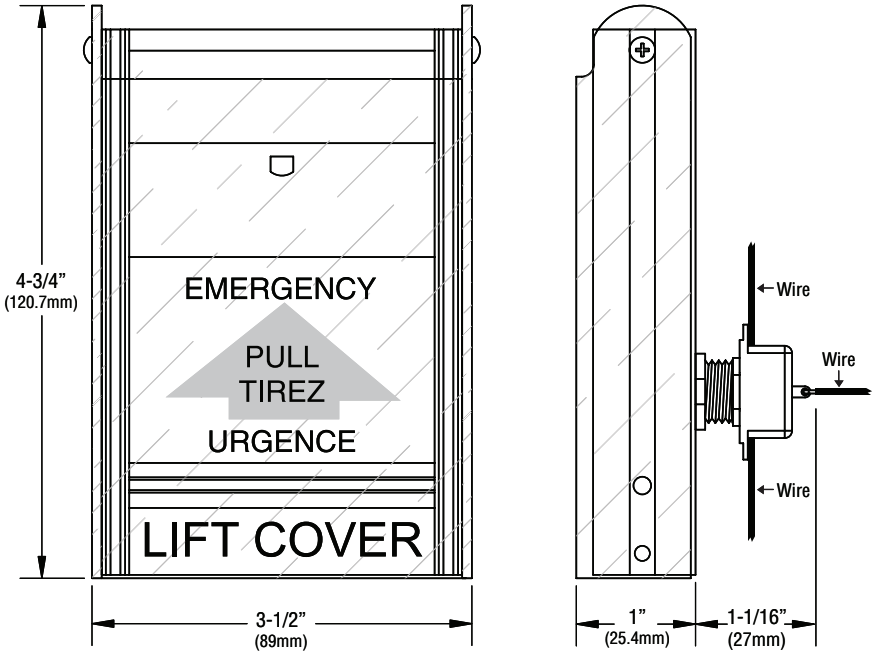

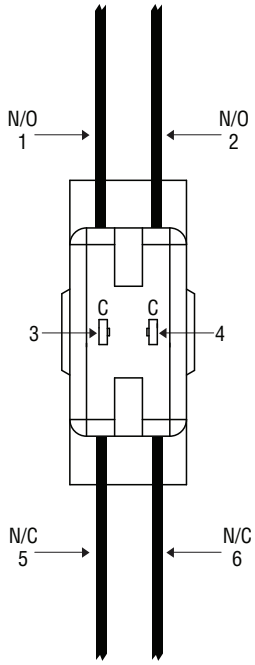

NOTE: This is a momentary switch that is held in the depressed position

Description	Switch Mode	Switch Configuration	Switch Rating	Standard Finis
904 Pull Station	Maintained Action	DPDT	3A @ 125VAC	Blue/Yellow

NOTE: Specifications are subject to change without notice.

©2013 RUTHERFORD CONTROLS • WWW.RUTHERFORDCONTROLS.COM
USA: 2517 SQUADRON COURT, SUITE 104, VIRGINIA BEACH, VA 23453 • CANADA: 210 SHEARSON CRESCENT, CAMBRIDGE, ON N1T 1J6
PHONE • 1.800.265.6630 • 519.621.7651 • FAX: 1.800.482.9795 • 519.621.7939 • E-MAIL: SALES@RUTHERFORDCONTROLS.COM

PCN120131
R04/13CM-5